


RECOMMEND SERVICE LINE FROM METER BOX TO HOME OR BUSINESS

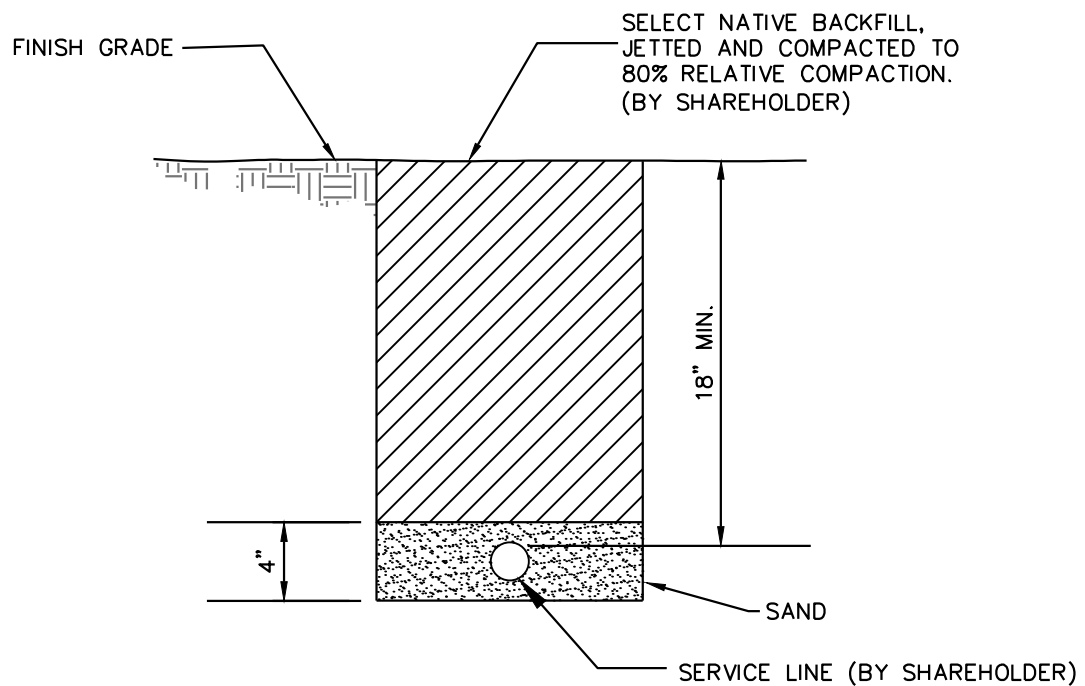

Notes

1. TRENCHING MACHINES SHOULD BE STOPPED AT LEAST 3 FEET FROM METER BOX. THE REMAINING TRENCH SHOULD BE HAND DUG. THE SHAREHOLDER SHALL NOT REMOVE OR DISTURB THE METER BOX. NO JETTING WILL BE ALLOWED WITHIN 5 FEET OF THE METER BOX. SHAREHOLDER SHALL HAND COMPACT THE BACKFILL AROUND THE BOX.
2. SELECT NATIVE BACKFILL SHOULD BE FREE OF LARGE ROCKS OR CHUNKS OF HARDPAN. HIGHLY EXPANSIVE SOIL SHOULD NOT BE USED AS BACKFILL.
3. REFERENCE TO SHAREHOLDER MEANS SHAREHOLDER OR CONTRACTOR.
4. SERVICE LINE MUST CONFORM TO THE UNIFORM PLUMBING CODE.

NOT TO SCALE

|               |  |                             |  |               |
|---------------|--|-----------------------------|--|---------------|
| REVISION DATE |  | MADERA VALLEY WATER COMPANY |  | Std. Dwg.     |
| 5AUG22        |  | SERVICE CONNECTION          |  | W-1<br>2 OF 2 |
|               |  |                             |  |               |
|               |  |                             |  |               |